


|  |  |   |
|--|--|---|
| <b>Chemical</b>                            | 2-Chloroethyl-Trimethyl-ammonium Chloride  | <b>Legend</b><br>○ agar plate Ames test (-S9)<br>△ agar plate Ames test (+10% S9)<br>□ agar plate Ames test (+30% S9)<br>● Ames MPF™ (-S9)<br>■ Ames MPF™ (+30% S9)<br><b>negative</b><br><b>weakly positive/equivocal</b><br><b>positive</b> |
| <b>CAS Nr.</b>                             | 999-81-5   |   |
| <b>Abbreviation</b>                        | Chlormerquat   |   |
| <b>Solvent</b>                             | H <sub>2</sub> O   |   |
| <b>Notes</b>                               | -  |   |
| <b>Source of agar plate Ames test data</b> | NTP database   |   |
| <b>Data Analysis</b>                       | Ames MPF™ data were analyzed according to the criteria described in [1]. Whenever available, the original evaluations of the agar plate Ames tests are reported. If no evaluation was provided, the criteria from [1] were applied.<br>[1]: Spiliopoulos & Koelbert. 2020. <i>Mutat Res.</i> 856–857:503218. |   |

For more information contact [info@xenometrix.ch](mailto:info@xenometrix.ch).

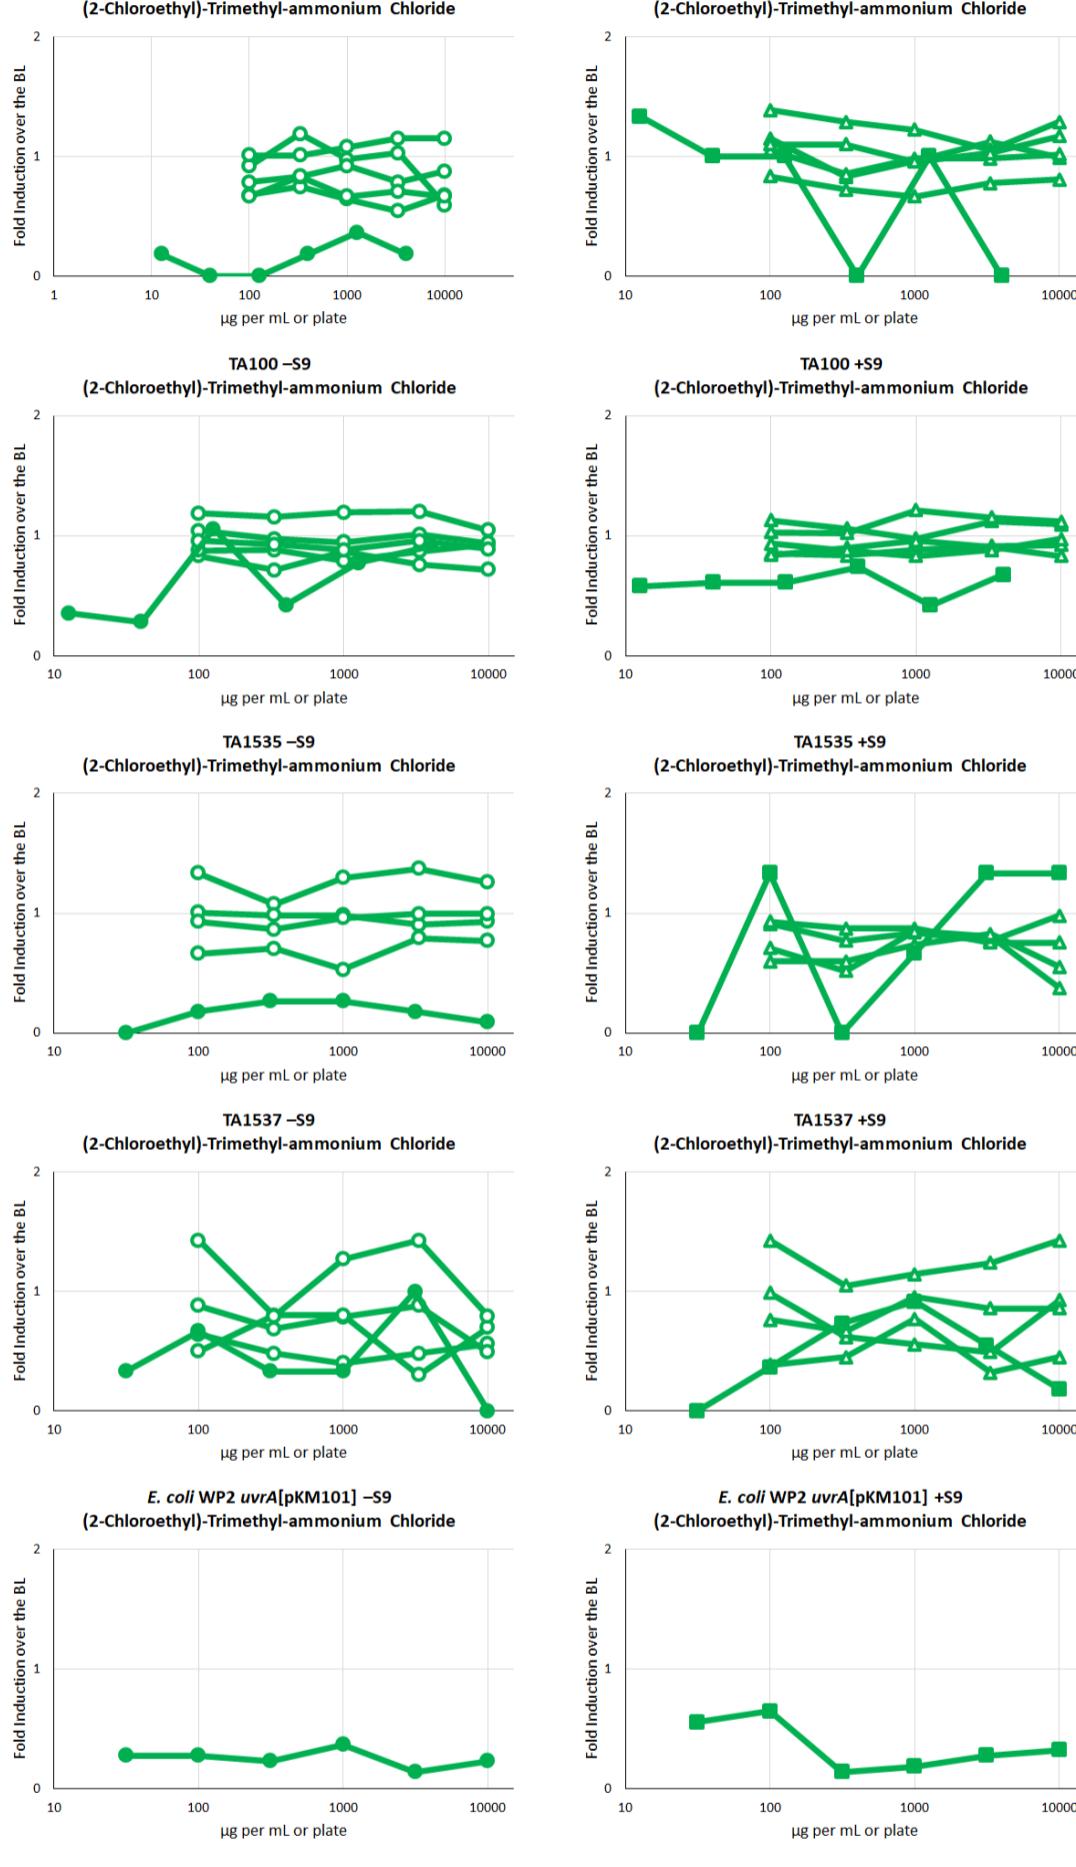

Copyright: Xenometrix AG